


Quick Touch Timer

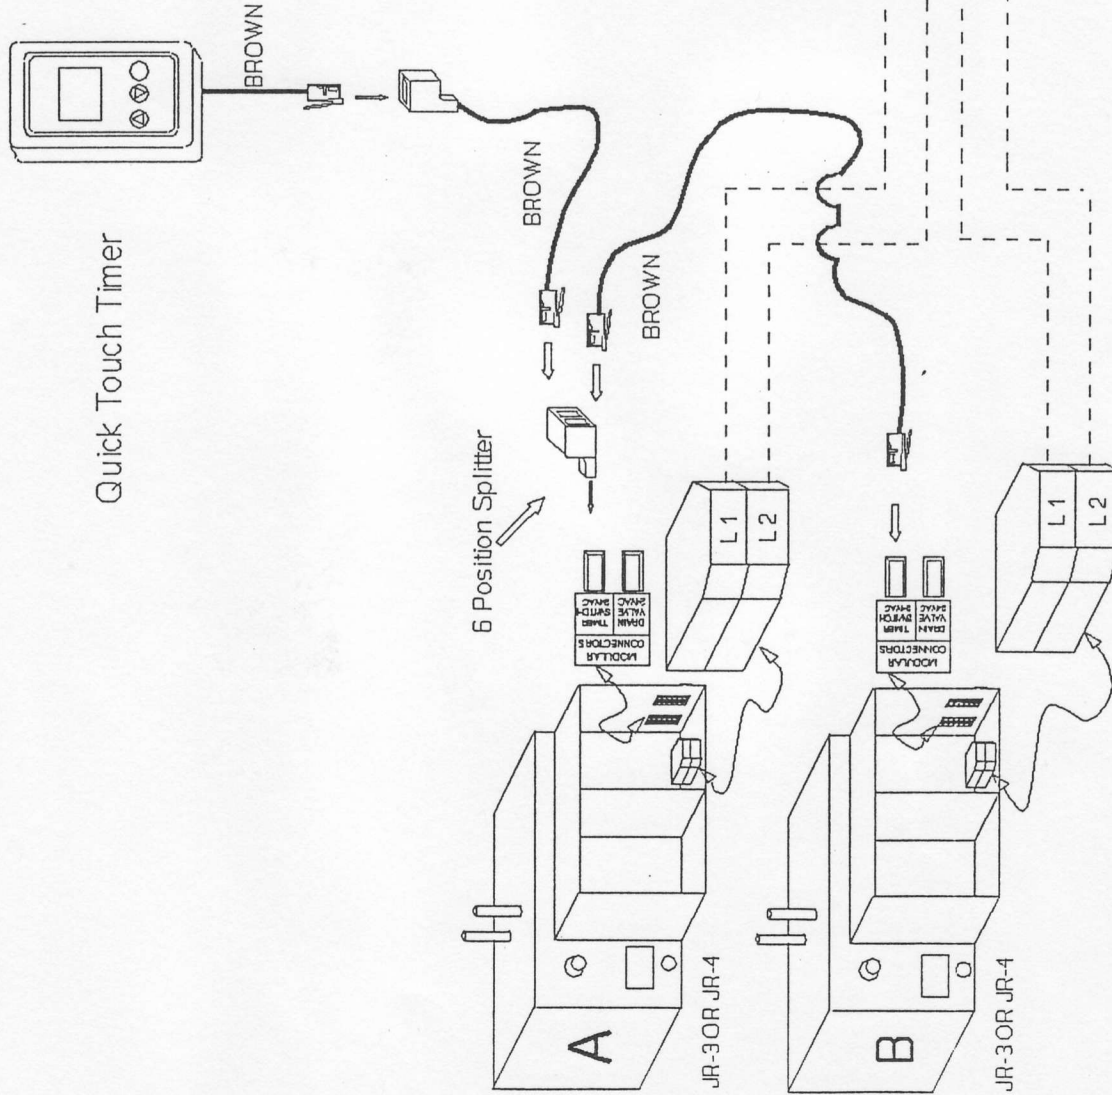

ELECTRICAL SUPPLY
208 OR 240 VOLT 1 PHASE

MANUAL DISCONNECT
CONTROLLING AND
VISIBLE FROM BOTH
GENERATORS
ACCORDING TO LOCAL
ELECTRICAL CODE

SPLITTER BOX WITH
FUSES FOR EACH
GENERATOR

6 Position Splitter

JR-3 OR JR-4

JR-3 OR JR-4

NOTES:

1. Polarity as shown MUST BE MAINTAINED at all times.
2. Dash Lines - - - - are for field installation.
3. Solid Lines - - - - are for Factory Supplied cord set field installation.
4. Installer to supply main disconnect, splitter box and appropriate fuses.
5. The thermostat recommended (or its equivalent) is a Johnson Controls model A-350 with a #SET189A-600R temperature sensor.
6. ALL Connectors MUST be as shown in above diagram
7. Power supply to thermostats and Timer - "Class 2 Energy Limiting."

LEISURE BATHS LTD.,TM

Multiple JR3 or JR-4 Steam Generator Connection

CONNECTION OF 2 STEAM GENERATORS IN
PARALLEL TO BE CONTROLLED BY
THE SAME TIMER SWITCH

Date 11/05/01
Drawn by DS

Drawing #JR345TK9.WPG
Revision #1